



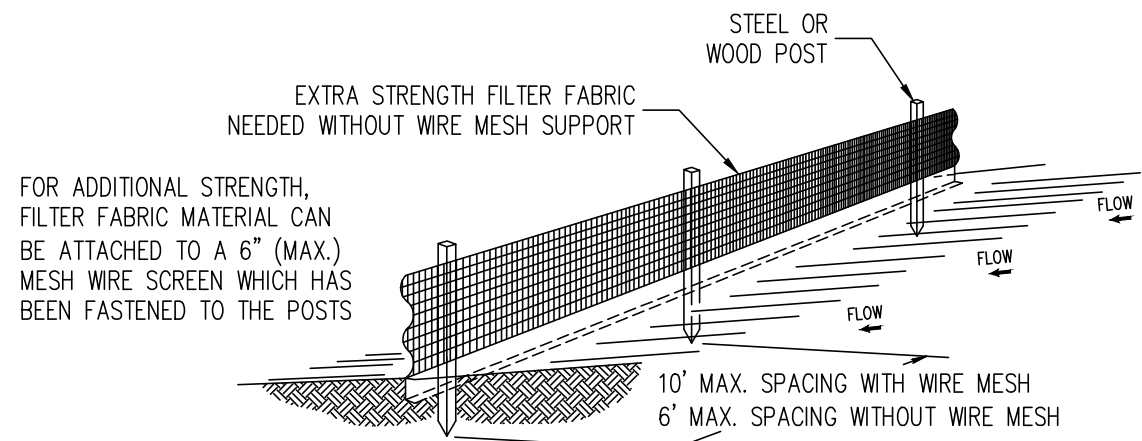


Notes:

- 1) The height of a silt fence shall not exceed 36".
- 2) Filter fabric shall be purchased in a continuous roll cut to the length of the barrier to avoid the use of joints.
- 3) Posts shall be spaced a maximum of 10' apart at the barrier location and driven securely into the ground a minimum of 12". When extra strength fabric is used without the wire support fence, post spacing shall not exceed 6".
- 4) A trench shall be excavated approximately 4" wide and 4" deep along the line of posts and upslope from the barrier.
- 5) When standard strength filter fabric is used, a wire mesh support fence shall be fastened securely to the upslope side of the posts using heavy duty wire staples at least 1" long, tie wires, or hog rings. The wire shall extend into the trench a minimum of 2" and shall not extend more than 36" above the original ground surface.
- 6) The standard strength filter fabric shall be stapled or wired to the fence, and 8" of the fabric shall be extended into the trench. The fabric shall not extend more than 36" above the original ground surface.
- 7) The trench shall be backfilled and the soil compacted over the filter fabric.

SILT FENCE DETAIL N.T.S.

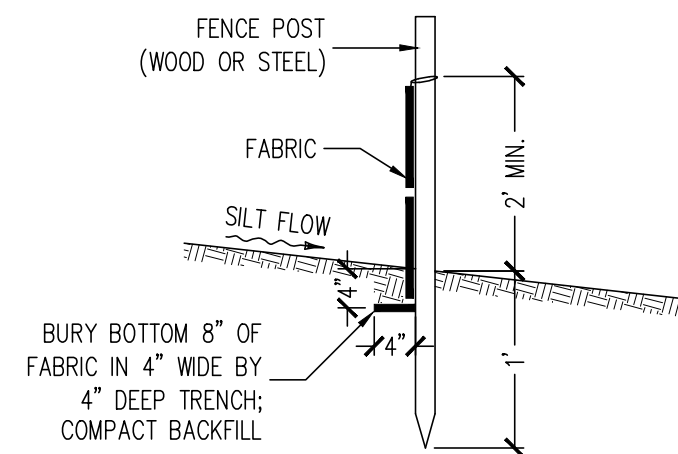



SILT FENCE SECTION N.T.S.

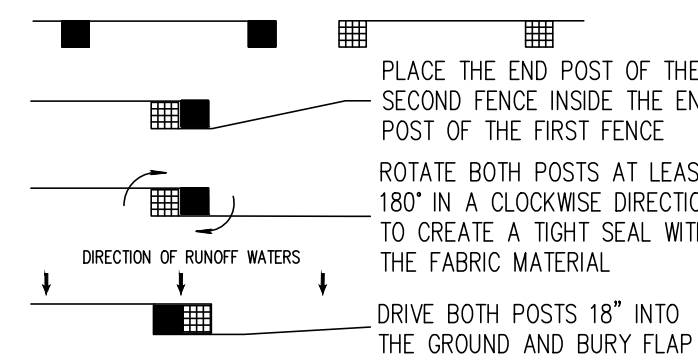



ATTACHING TWO SILT FENCES N.T.S.

Notes:

- 1) Contractor is responsible for installing and maintaining erosion control measures during construction.
- 2) Contractor to investigate condition of existing sewer service prior to building permit submittal. If existing service is cast iron, or in poor condition, service will be replaced to main per Town of Palm Beach standards.

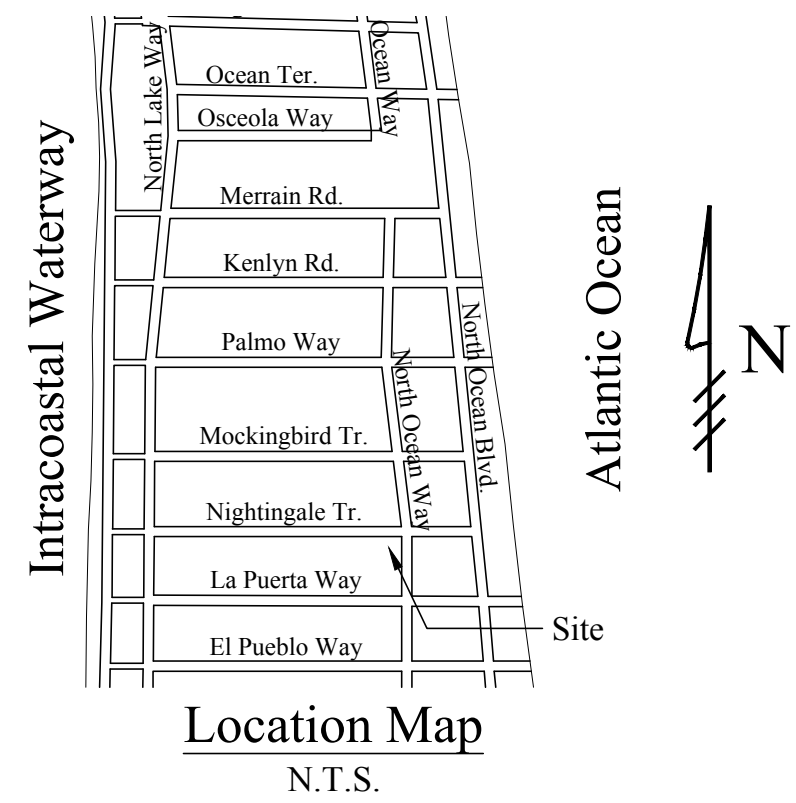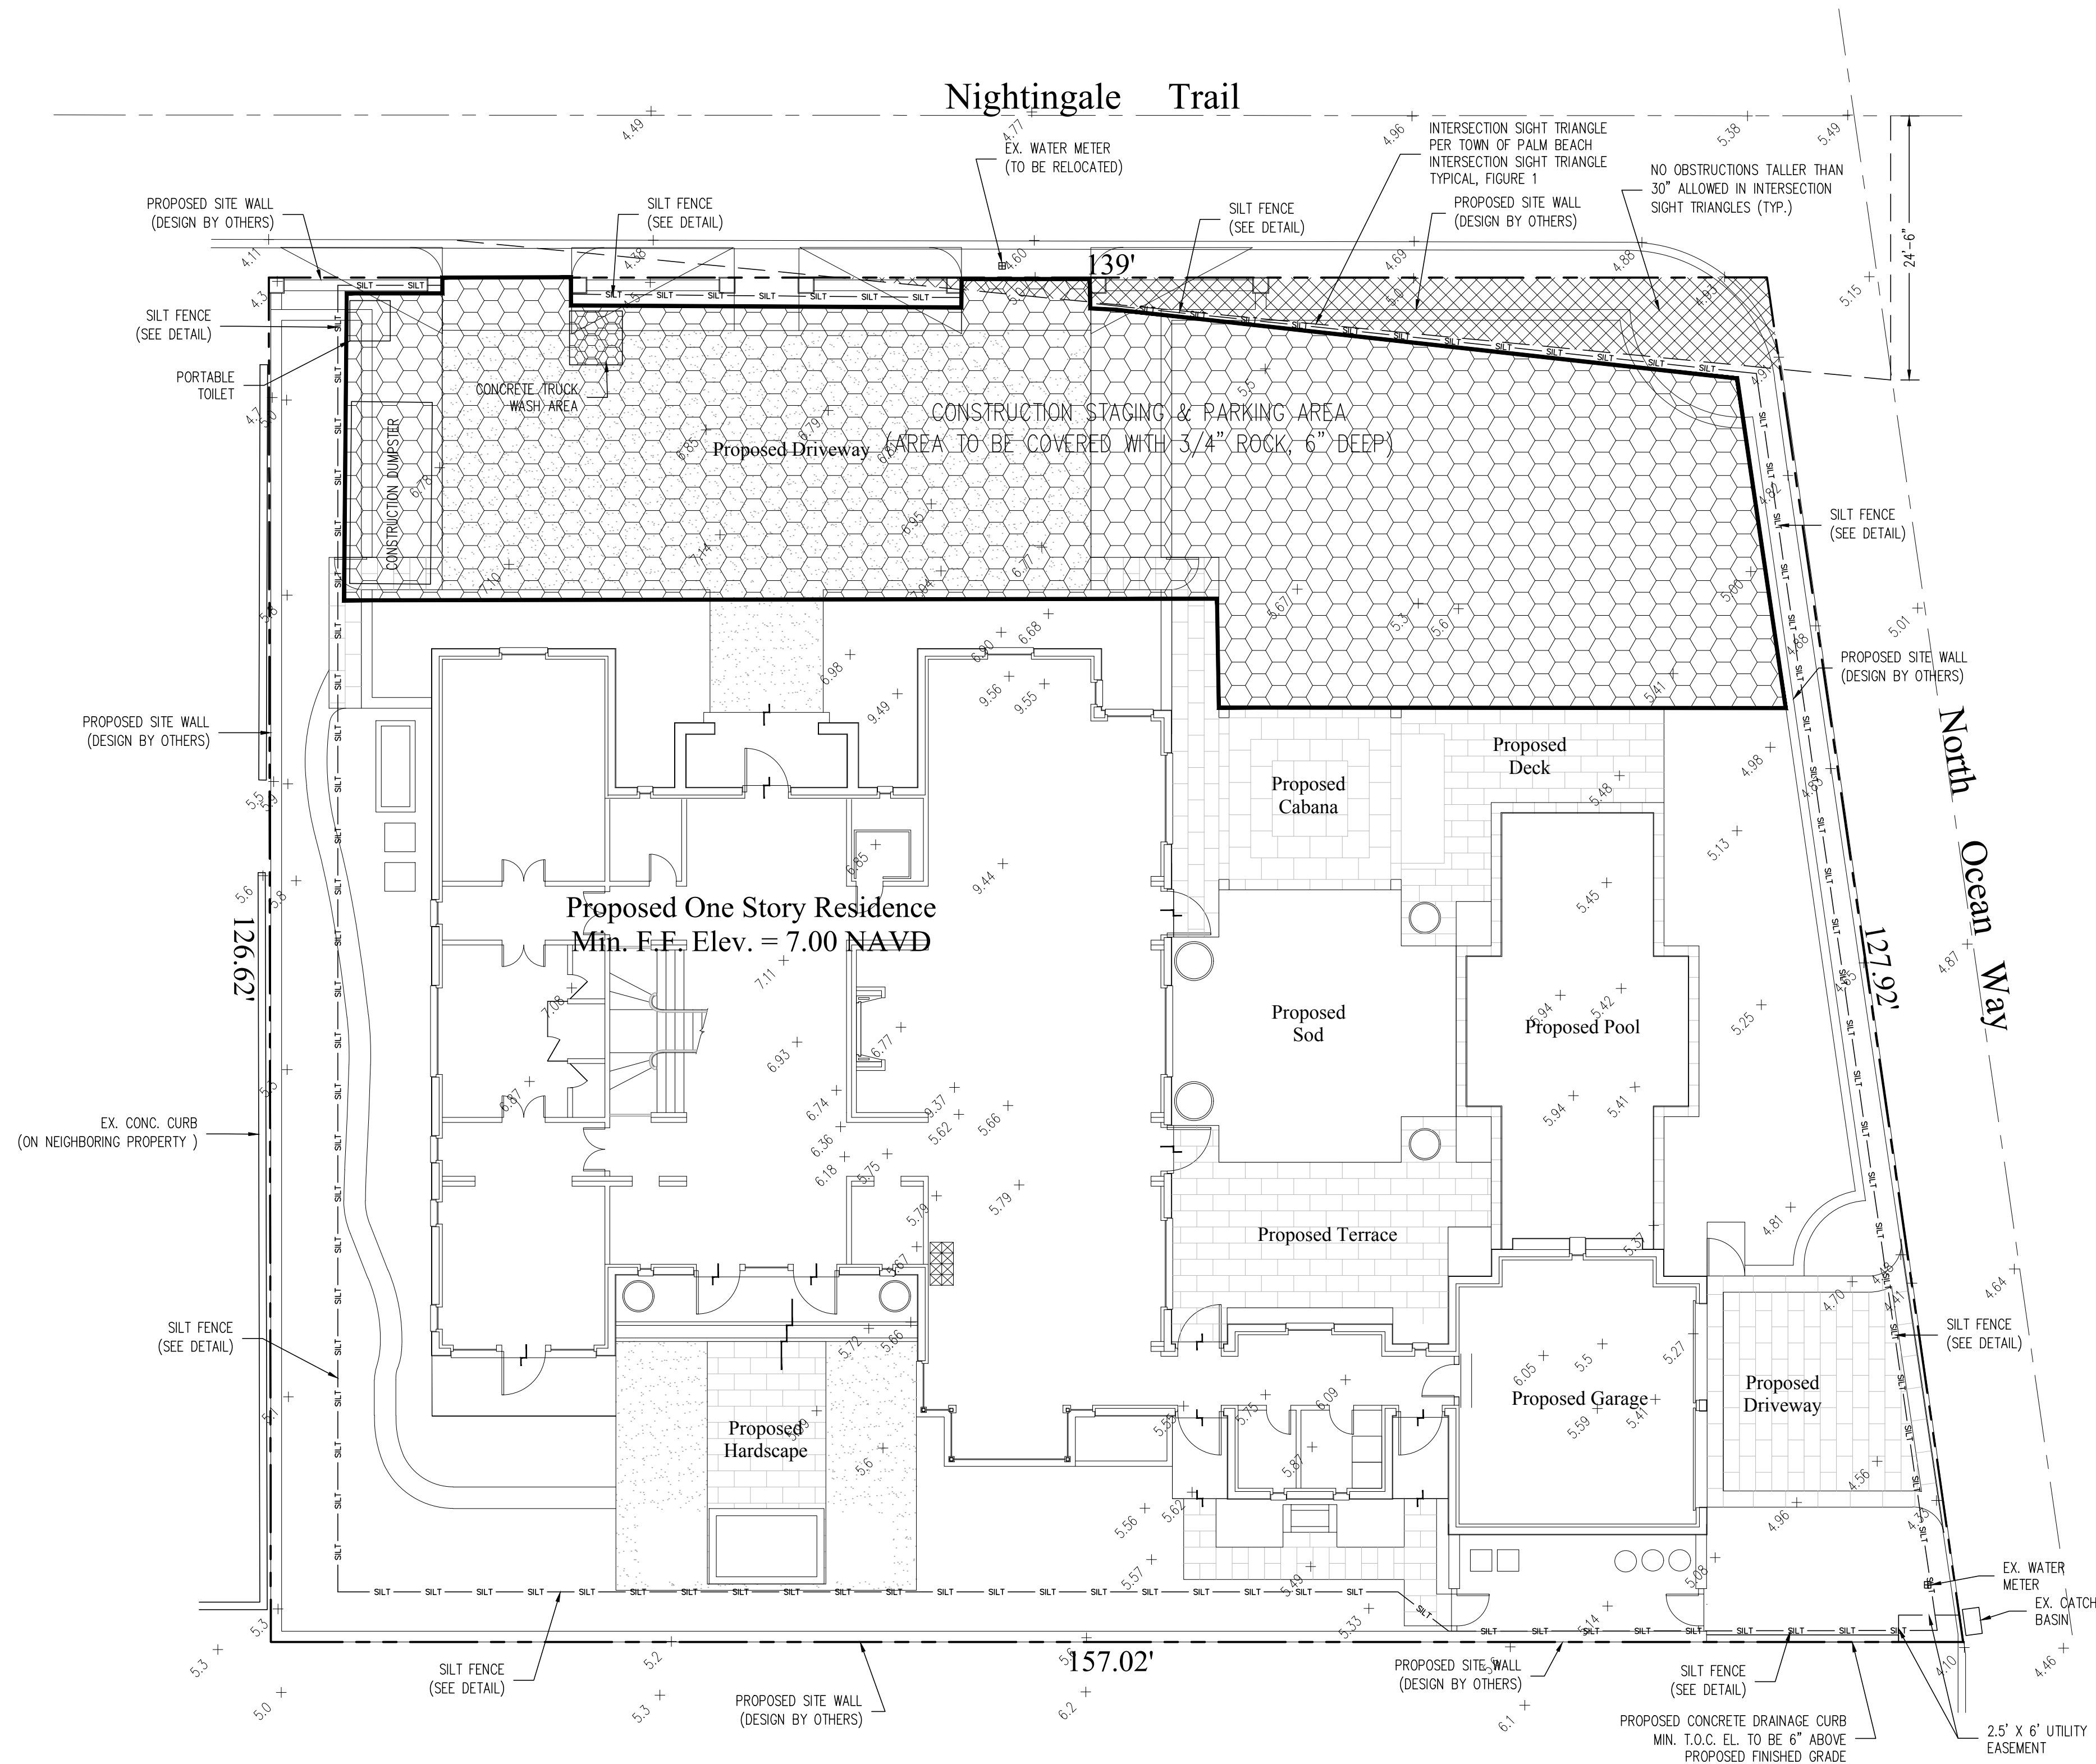

Legend

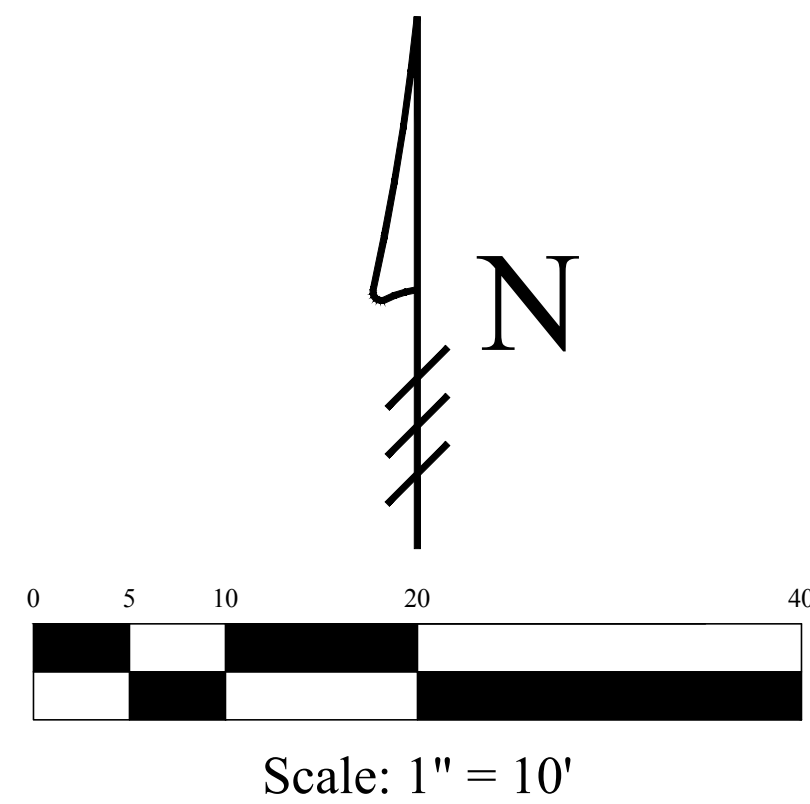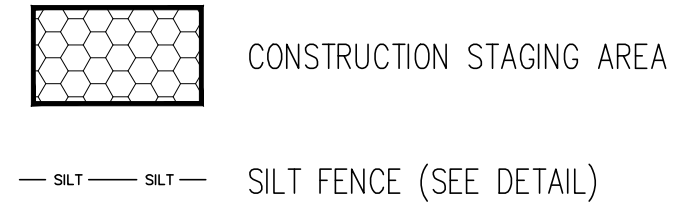

Gruber Consulting Engineers, Inc.
575 MERCER AVE., SUITE 305
WEST PALM BEACH, FL 33401
PHONE: 561.312.2841
office@gruberengineers.com

Project Information				
Project No.	2023-0018	Issue Date	09/19/2023	Scale
Scale	1" = 10'	Drawn By	KM	Checked By
Checked By	CG			

Conceptual Construction Staging & Parking and Erosion Control Plan For:
Proposed Residence
1186 North Ocean Way
Palm Beach, Florida

Revisions	
1	
2	
3	
4	
5	
6	
7	
8	
9	
10	

Chad M. Gruber
FL P.E. No. 57466

Sheet No.
EC-1

This item has been electronically signed and sealed by Chad M. Gruber on the date adjacent to the seal using a SHA authentication code. Printed copies of this document are not considered signed and sealed and the SHA authentication code must be verified on any electronic copies.

Plan Background from Hardscape Plan by Nievera Williams Design Received 9/14/23

ARC-23-123
ZON-23-105

© 2023 Gruber Consulting Engineers, Inc.