



TOWN OF PALM BEACH MARINA/DOCKS PROJECT

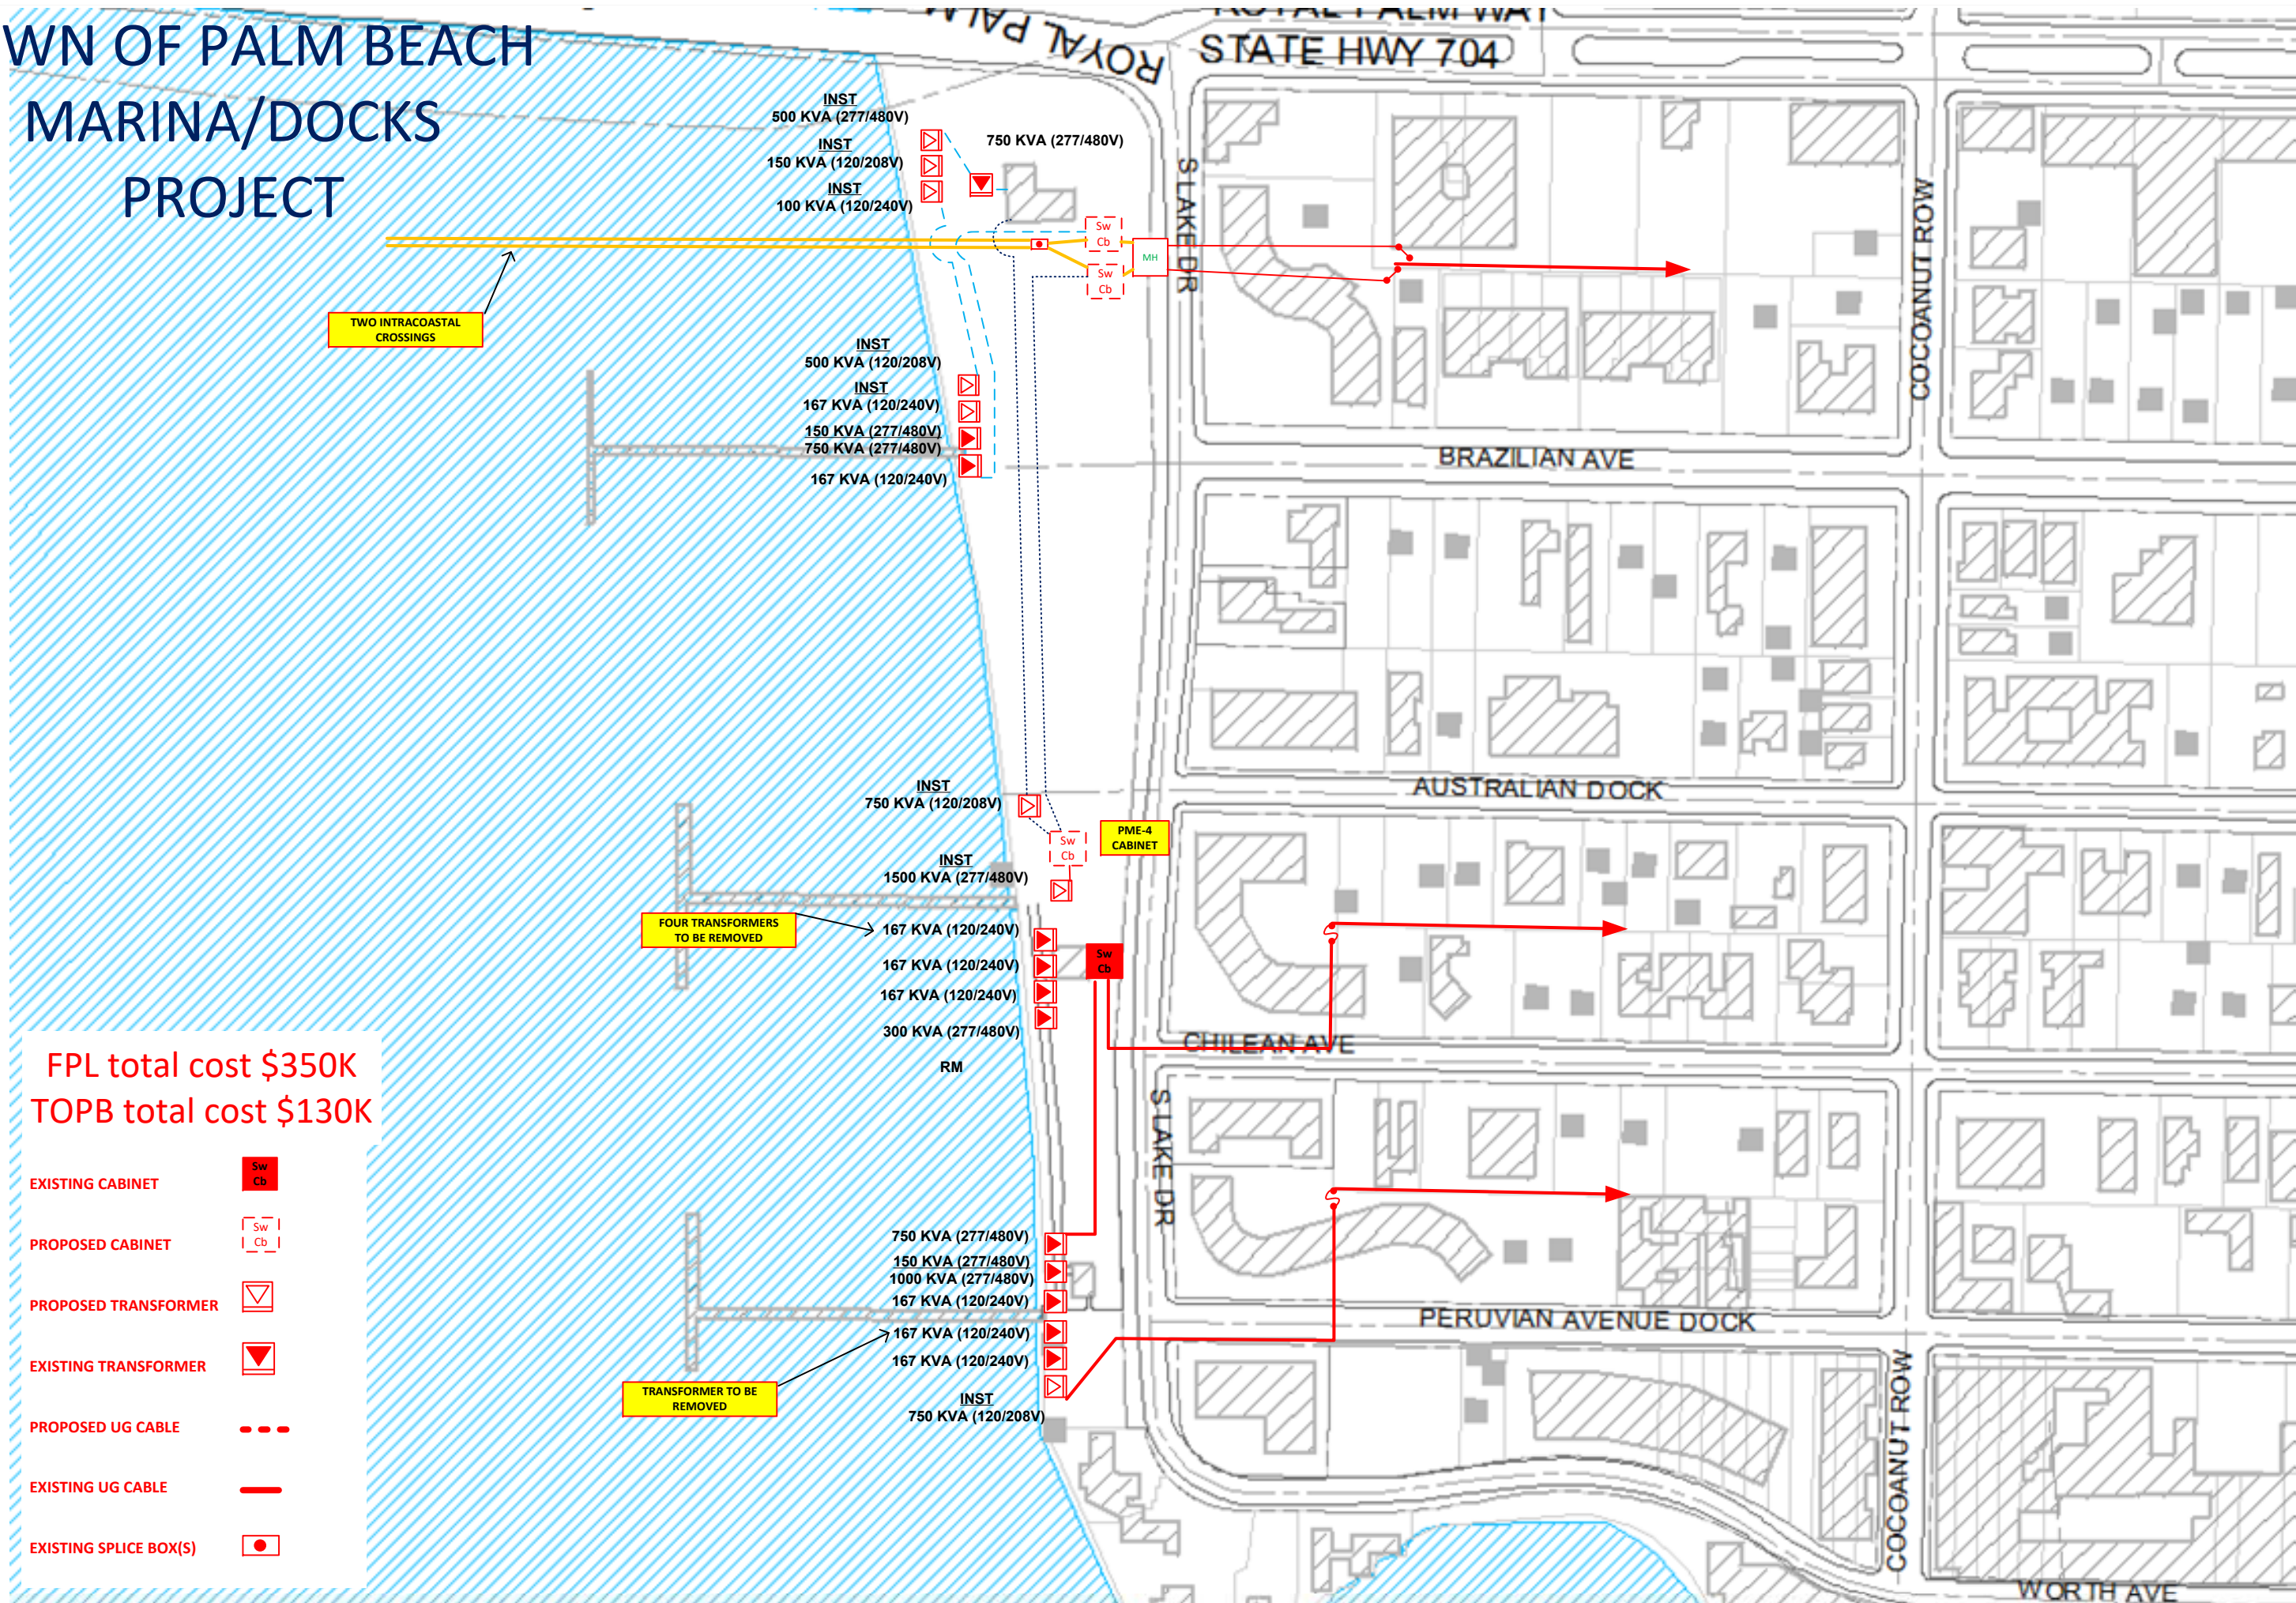

FPL total cost \$350K
TOPB total cost \$130K

The location and existence of any facilities may not be relied upon by the supplier in responding to a bid or in complying with any contract. Supplier is responsible for evaluating site conditions both above and below ground including underground facility locations.

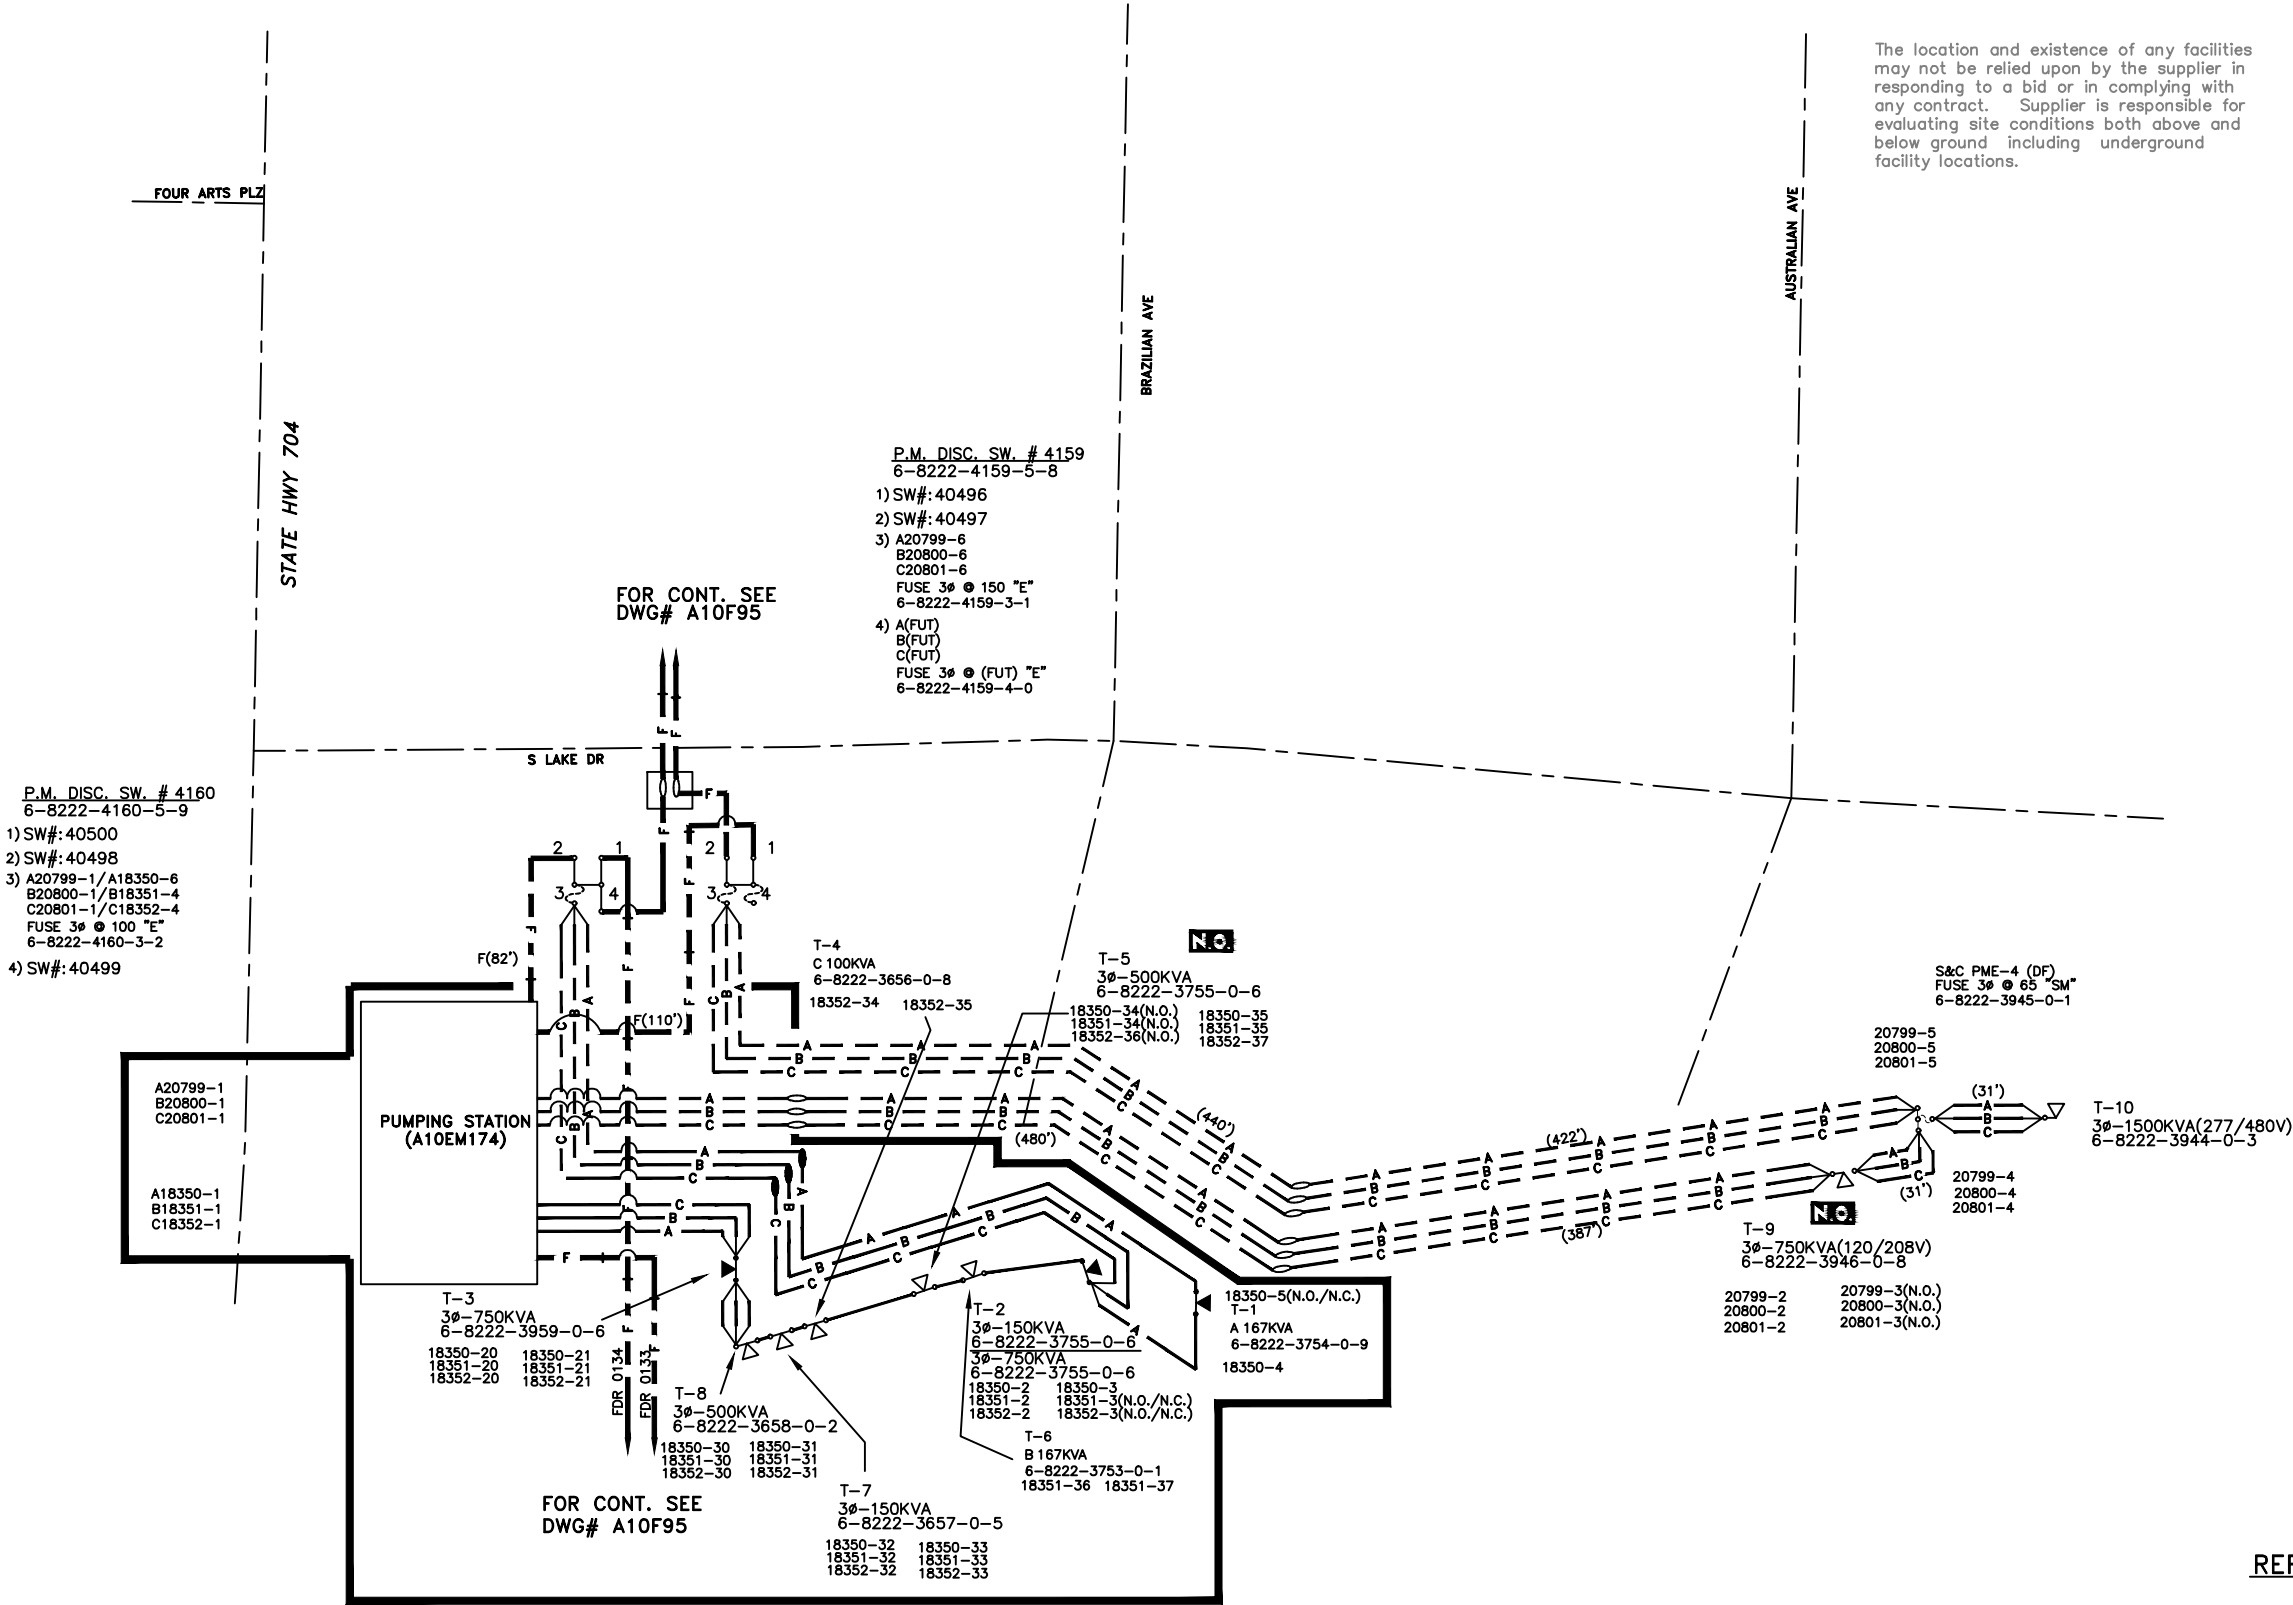

REFERENCE DWG's

A10EM174
A10F95
A10PP66
A10R446
A10BR184

TWNP: 43 RING: 43 SEC: 22 QTR: Q

AS-BUILT COPY		AS-BUILT CREW PRINT	
Initials	Cert. Date	Foreman's Signature	Date
Job CERTIFIED COMPLETED as shown on this AS-BUILT print. Material changes shown on ROS.			
Supervisor's Signature		Date	
All required ground rods Have been driven & verified to be within FPL standards. Values are shown at all locations.			
Foreman's Signature		Date	

Easement?	YES ☐ NO ☐	Survey/Stake?	YES ☐ NO ☐	Work with SMO?	YES ☐ NO ☐
Tree Work?	YES ☐ NO ☐	Designer/Stake?	YES ☐ NO ☐	CT/Special Mtr?	YES ☐ NO ☐
Map Posting?	YES ☐ NO ☐	Trench Feet		Duct Bank Feet	
Posted by		Telephone Request?	YES ☐ NO ☐	CATV Request?	YES ☐ NO ☐



DESIGNED BY	E. TROCHEZ
DRAWN BY	K. LOPEZ
DATE	08/26/19
MAP NO.	M-0438

M/A: WB	
PALM BEACH DOCKS	
LAKE DR S/O ROYAL PALM WAY WEST PALM BEACH/PALM BEACH CNTY, FL	
DWG NO.	A10CK447
WR: 8878271	IWR: D088-78-271

	8878271	1	08/26/19	INST TX'S
	8891074	0	07/16/19	CUT IN 2 SW CAB'S & PULL PRI CBL & INST PRI DEVICES
ASBUILT	AUTH NO.	NO.	DATE	REVISION


ATTENTION
PLEASE PROVIDE STREET ADDRESSES FOR THIS AREA.

CHECK PRINT		DATE: 7/1/2019	
JOB NO.: 8819881		NO: 1	
CADTECH: A. DIAZ			
AT THE AMG/CSE OFFICE		PH:	
ROUTE TO		INITIAL	DATE
1			
2	B. THOMAS		
NUM/SIZE OF FINAL PRINTS		B- D- E-	
SEND JOBPRINTS TO:		WBA-WP2	

* FACILITIES SHOWN EXISTING ARE
SUBJECT TO CONFIRMATION BY
AN "AS-BUILT" PRINT

A10R45
A10R126
A10CV55



TWNP: 43S RNG: 43E SEC: 27 QTR: _____

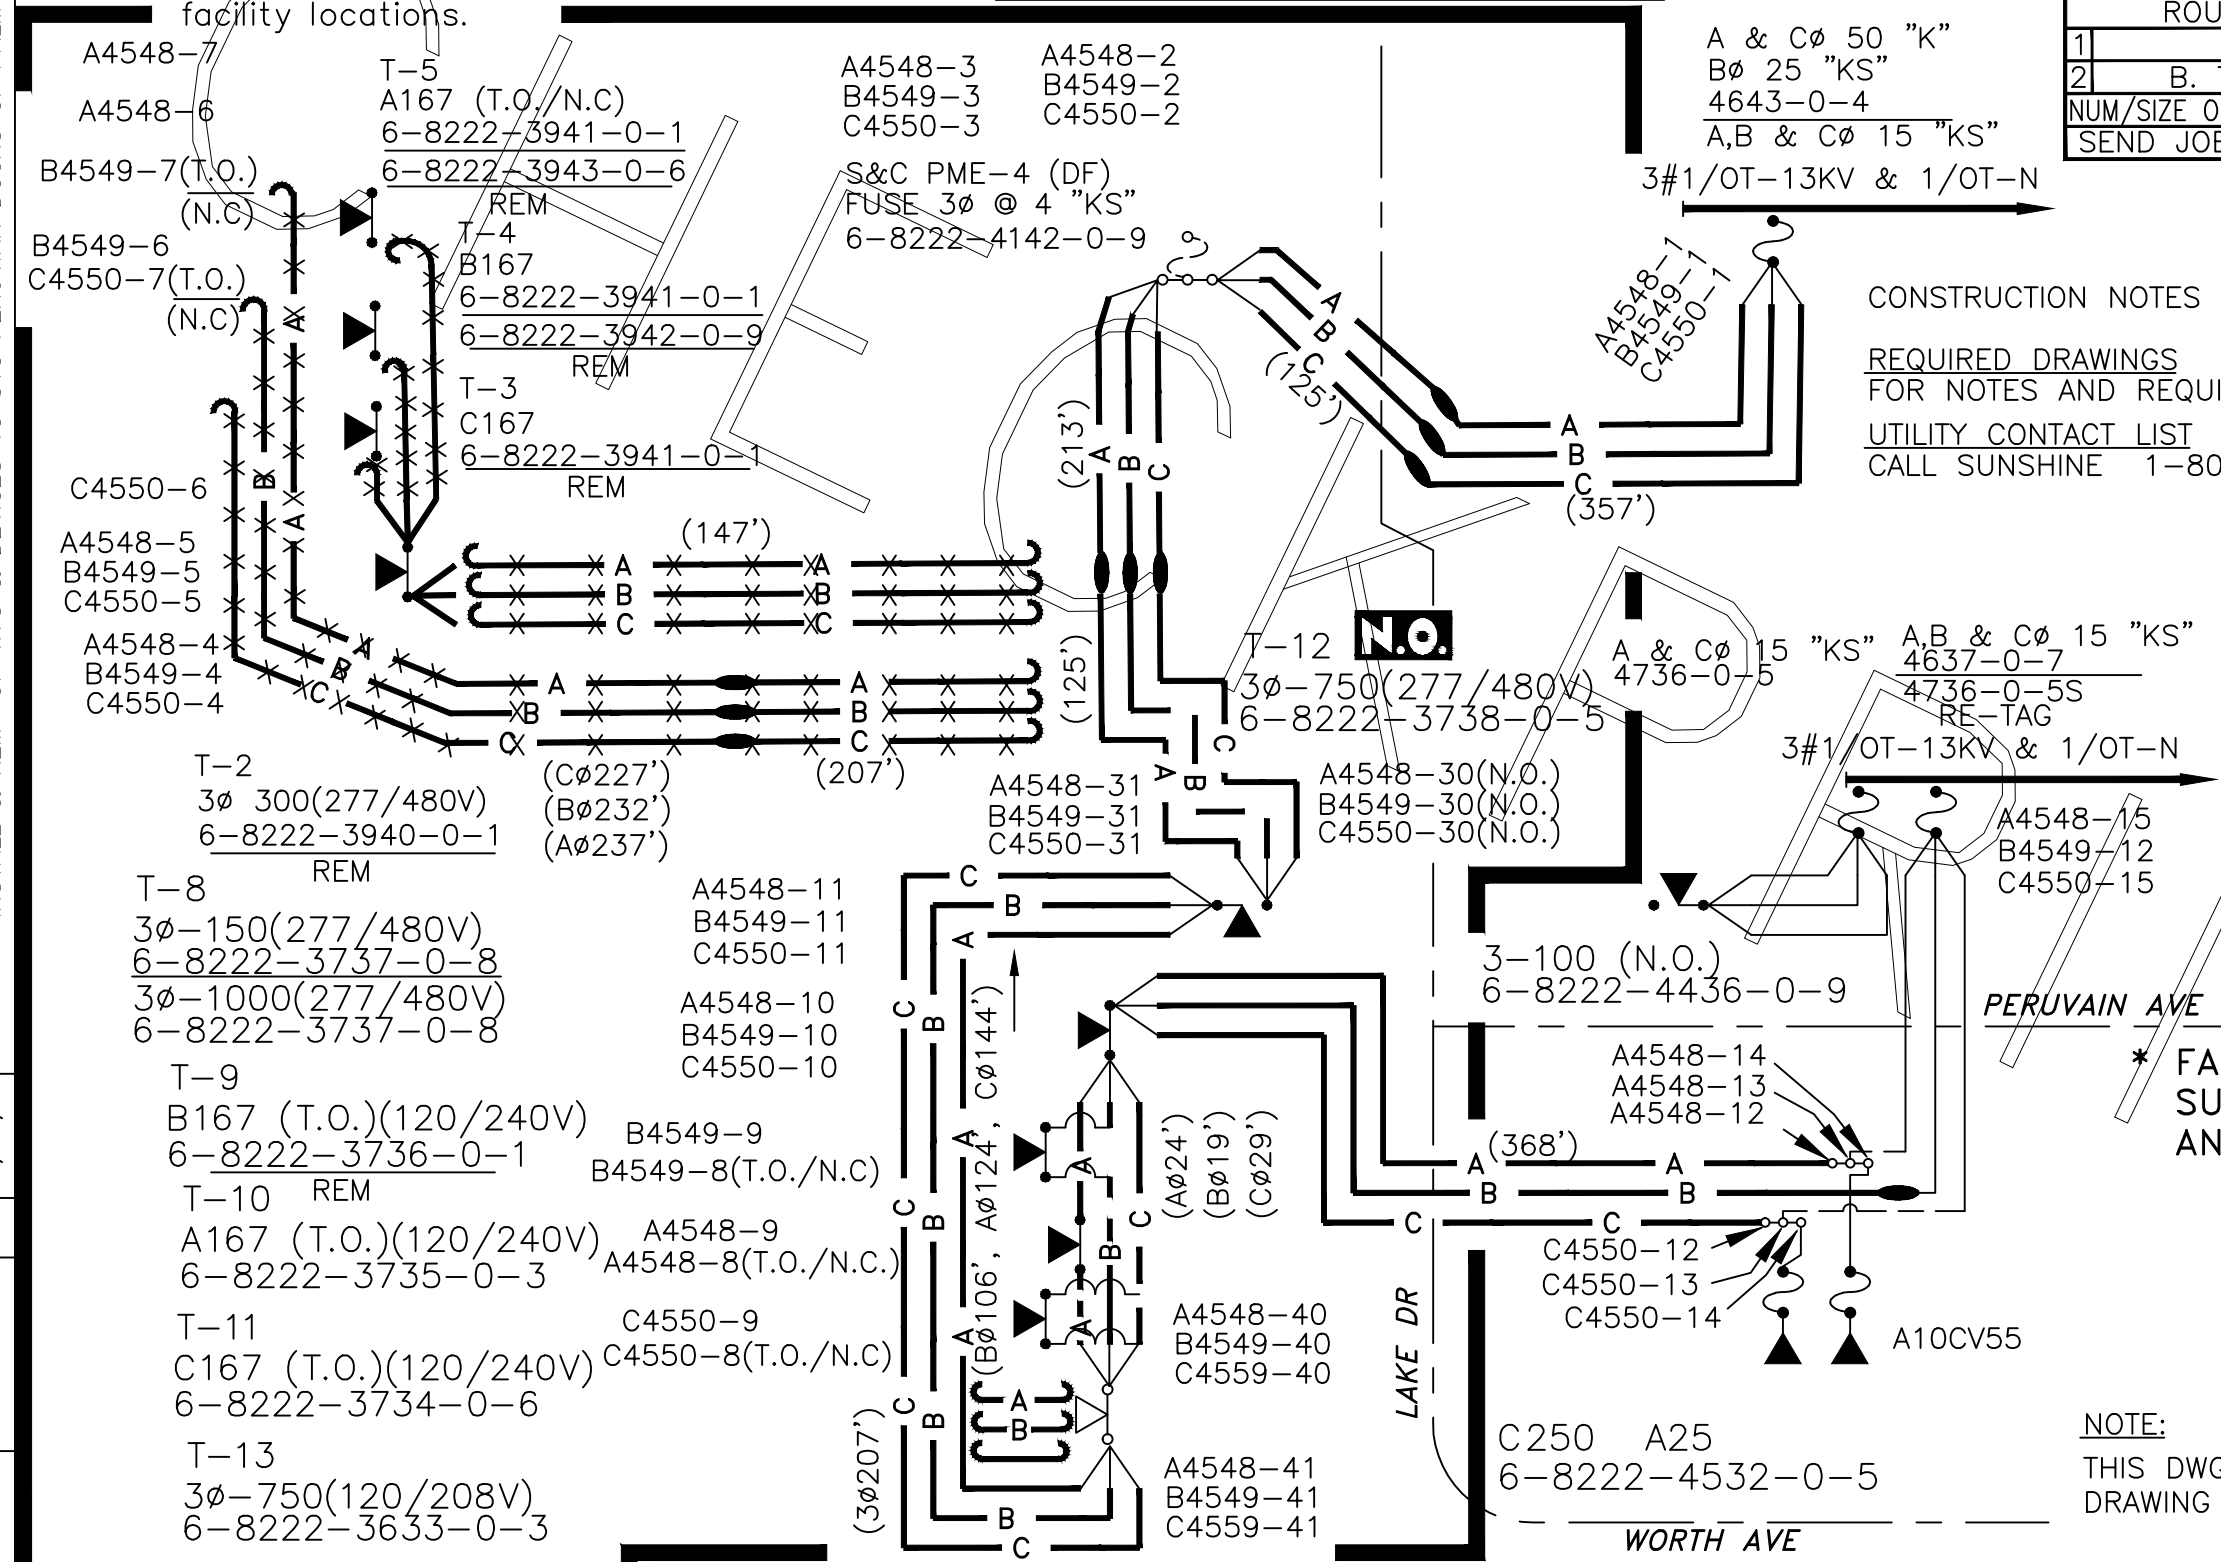

ASBUILT	AUTH NO.	NO.	DATE
SEE REV2	1276-07-454	1	02/12/97
09/29/15	5923990	8	01/05/15
	8819881	9	07/01/19

AS-BUILT COPY		AS-BUILT CREW PRINT		Easement? YES ☒ NO ☐		Survey/Stake? YES ☒ NO ☐		Work with SMO? YES ☐ NO ☒		 	DESIGNED BY		B. THOMAS		M/A: WB AUSTRALIAN DOCKS OF PALM BEACH W/S/O LAKE DR. S/O AUSTRALIAN AVE. WEST PALM BCH/PALM BCH CNTY, FL		
Initials		Cert. Date		Tree Work? YES ☐ NO ☐		Designer/Stake? YES ☐ NO ☒		CT/Special Mtr? YES ☐ NO ☒			DRAWN BY		A. DIAZ				
Job CERTIFIED COMPLETED as shown on this AS-BUILT print. Material changes shown on ROS.				Map Posting? YES ☒ NO ☐		Trench Feet			Duct Bank Feet			DATE		07/01/19			
Supervisor's Signature _____				DDBS		PERMIT REQ'D	CITY		DR. DIST.		COUNTY AIR		STATE RD		FAA		
All required ground rods Have been driven & verified to be within FPL standards. Values are shown at all locations.				Posted by			WMD		RR XING		COUNTY RD.		TRANSM.				
Foreman's Signature _____				Telephone Request? YES ☐ NO ☒		CATV Request? YES ☐ NO ☒					0		N.T.S.		DWG NO. A10CK17		
Date _____												FEET		WR: 8819881 IWR: D088-98-881			

PLOT DATE: 7/2/2019 PLOT TIME: 2:08:12 PM CAD NAME: AXD

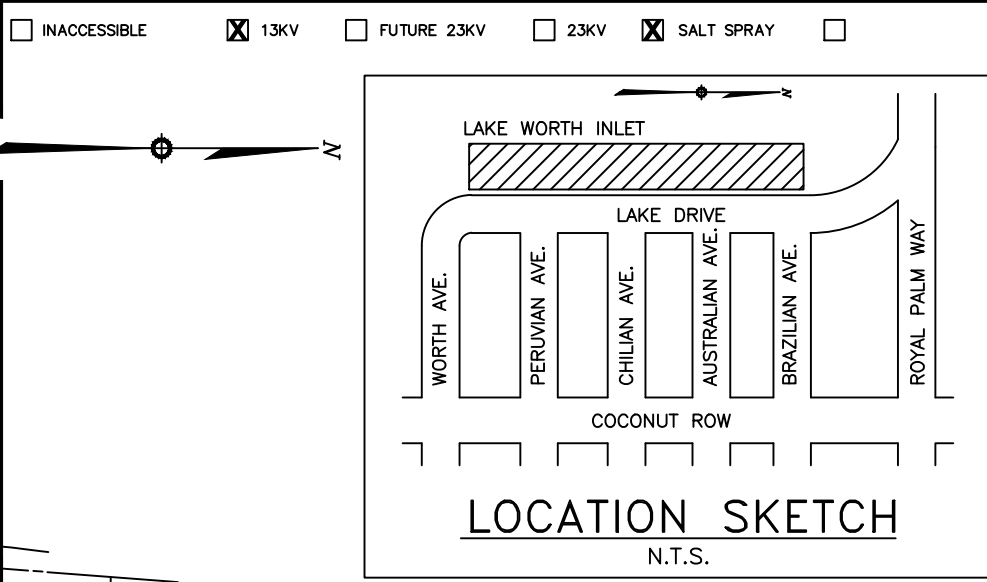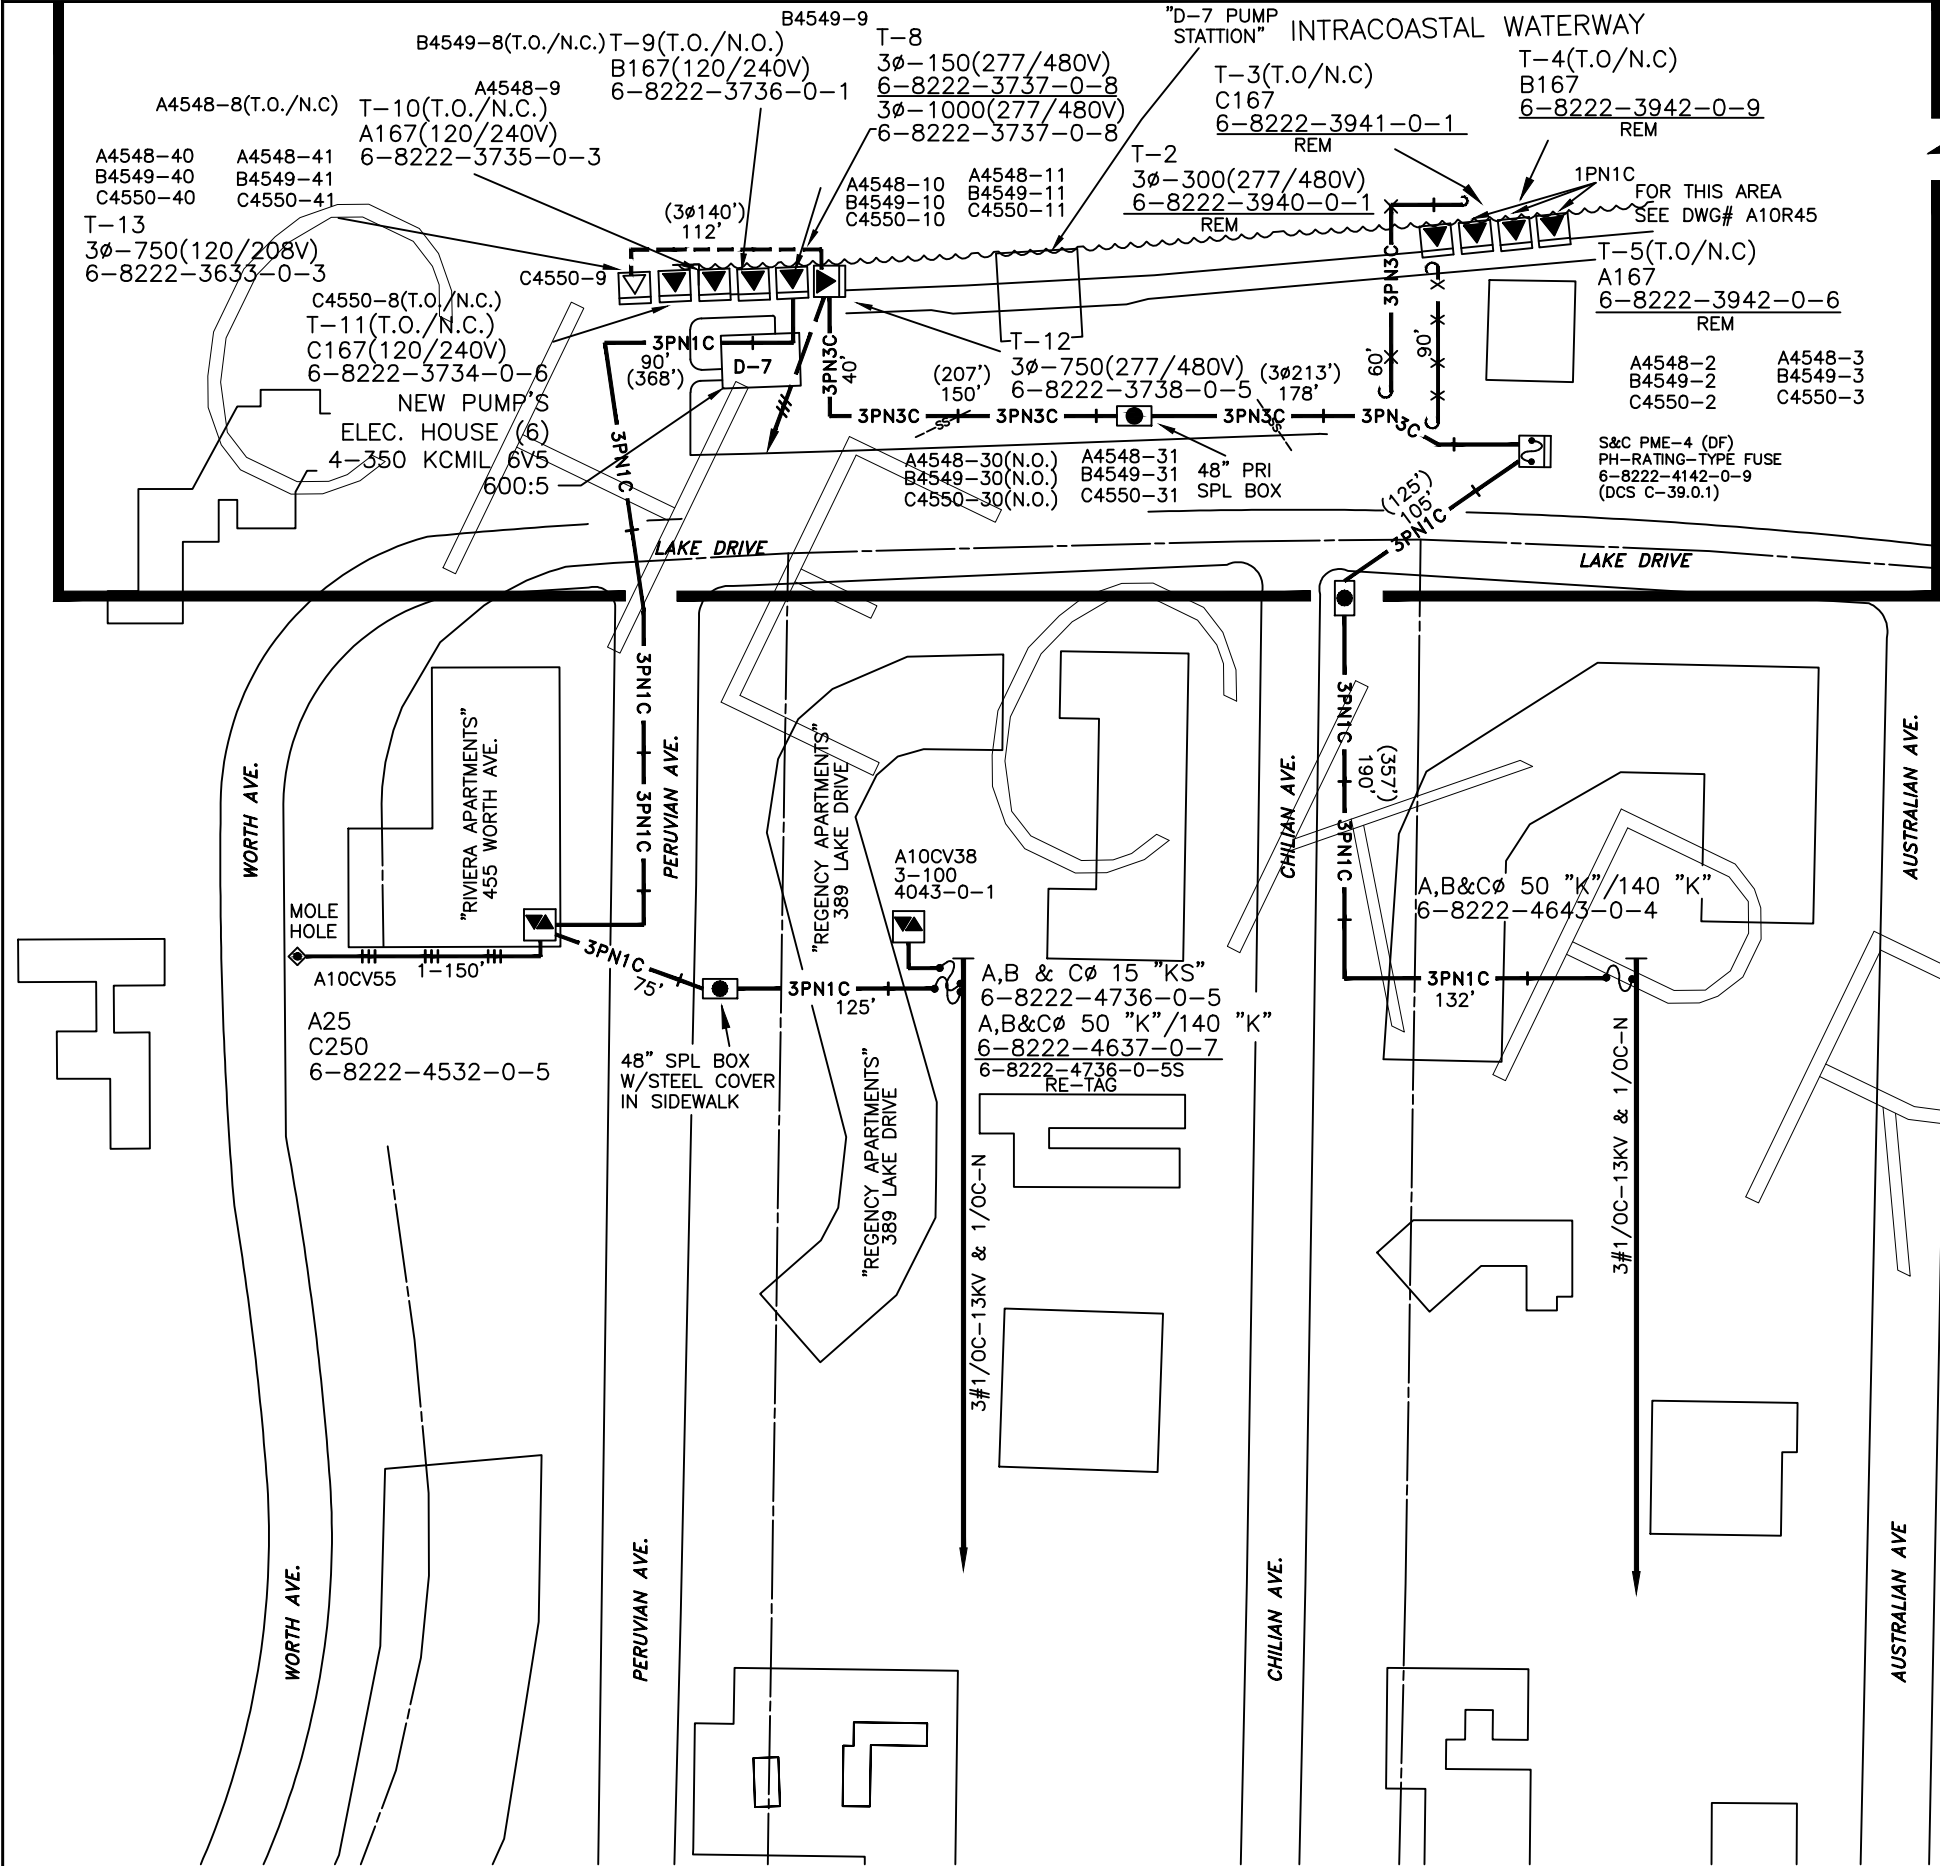

CHECK PRINT		DATE: 7/1/2019
JOB NO.:	8819881	NO: 1
CADTECH:		
AT THE AMG/CSE OFFICE/PH:		
ROUTE TO	INITIAL	DATE
1		
2	B. THOMAS	
NUM/SIZE OF FINAL PRINTS	B-	D- E-
SEND JOBPRINTS TO:	WBA-WP2	

CONSTRUCTION NOTES - WR# 8819881

REQUIRED DRAWINGS
A10R126(NOTES)
A10CK17
CUSTOMER INSTALLED CONDUIT
CUSTOMER INSTALLED ALL CONDUIT
CABLE
3PN1C IS 3CC #1/0A 25KV-XLPE IN 1-5" PVC WITH 36" MIN COVER
STANDARD NOTES
ALL CABLE AND/OR CONDUIT ENDS ARE TO BE MARKED WITH AN ELECTRONIC MARKER
(XXX) DENOTES CABLE PULL DISTANCE
UNDERGROUND OBSTRUCTIONS ARE TO BE LOCATED PRIOR TO DIGGING
INSTALL NEUTRAL BOND FOR COMMUNICATION COMPANIES AT ALL SINGLE PHASE
TRANSFORMERS PER D.C.S., G-11.0.0
UTILITY CONTACT LIST
CALL SUNSHINE 1-800-432-4770

Ground Rod Information		
Location	Feet of Ground Rod Installed	Resistance (Ohms)

The location and existence of any facilities may not be relied upon by the supplier in responding to a bid or in complying with any contract. Supplier is responsible for evaluating site conditions both above and below ground including underground facility locations.

MULTIPLE JOBS

1763-7-454

1837-7-454

REFERENCE DWG's

A10R45
A10CK17
A10CV55

TWNP: 433 RNG: 43E SEC: 27 QTR: NE

8819881 7 07/01/19 INSTALL & REM 30 TX'S & DEVICES TO SVC PERUVIAN DOCKS OF PALM BEACH				AS-BUILT COPY		AS-BUILT CREW PRINT		Easement? YES ☒ NO ☐		Survey/Stake? YES ☒ NO ☐		Work with SMO? YES ☐ NO ☒			DESIGNED BY B. THOMAS		W/A: WB PERUVIAN DOCKS OF PALM BEACH W/S/O LAKE DR. S/O AUSTRALIAN AVE. WEST PLAM BCH/PALM BCH CNTY, FL A10R126 DWG NO. 8819881 IWR: D088-98-881	
09/25/15 5923990 6 01/05/15 REPL C167KVA WITH C250KVA TX				Initials Cert. Date Foreman's Signature Date		Job CERTIFIED COMPLETED as shown on this AS-BUILT print. Material changes shown on ROS.		Tree Work? YES ☐ NO ☐		Designer/Stake? YES ☐ NO ☒		CT/Special Mtr? YES ☐ NO ☒			DRAWN BY A. DIAZ			
1837-7-454 1 07/13/98 RM TX'S & FACILITIES @ LOC'N 5 & CUT & PLUG CONDUIT, INSTALL ECM, RM CABLE @ LOC'N 4				Supervisor's Signature Date		All required ground rods have been driven & verified to be within FPL standards. Values are shown at all locations.		Map Posting? YES ☒ NO ☐		Trench Feet		Duct Bank Feet			DATE 07/01/19			
ASBUILT AUTH NO. NO. DATE REVISION				Foreman's Signature Date		Posted by		Telephone Request? YES ☐ NO ☒		CATV Request? YES ☐ NO ☒		MAP NO. L-0438			0 30 60 120 FEET			

PLOT DATE: 8/30/2019 PLOT TIME: 2:35:48 PM CAD NAME: SXL

	8878271	1	08/26/19	INST TX'S
	8891074	0	07/16/19	CUT IN 2 SW CAB'S & PULL PRI CBL & INST PRI DEVICES
ASBUILT	AUTH NO.	NO.	DATE	REVISION

AS-BUILT COPY		AS-BUILT CREW PRINT	
Initials	Cert. Date	Foreman's Signature	Date
Job CERTIFIED COMPLETED as shown on this AS-BUILT print. Material changes shown on ROS.			
Supervisor's Signature		Date	
All required ground rods Have been driven & verified to be within FPL standards. Values are shown at all locations.			
Foreman's Signature		Date	

Easement?	YES ☐ NO ☐	Survey/Stake?	YES ☐ NO ☐	Work with SMO?	YES ☐ NO ☐
Tree Work?	YES ☐ NO ☐	Designer/Stake?	YES ☐ NO ☐	CT/Special Mtr?	YES ☐ NO ☐
Map Posting?	YES ☐ NO ☐	Trench Feet	Duct Bank Feet		
FPL RECORD	CITY	DR. DIST.	COUNTY AIR	STATE RD	FAA
	WMD	RR XING	COUNTY RD.	TRANS.	
Posted by	Telephone Request? YES ☐ NO ☐		CATV Request? YES ☐ NO ☐		




DESIGNED BY	B. THOMAS
DRAWN BY	K. LOPEZ
DATE	08/26/19
MAP NO.	M-0438

M/A: WB	
PALM BEACH DOCKS	
LAKE DR S/O ROYAL PALM WAY WEST PALM BEACH/PALM BEACH CNTY, FL	
DWG NO.	A10R446
WR: 8878271	IWR: D088-78-271

TWNP: 43 RING: 43 SEC: 22 QTR: Q

☐ INACCESSIBLE ☒ 13KV ☐ FUTURE 23KV ☐ 23KV ☐ SALT SPRAY ☐ NULL

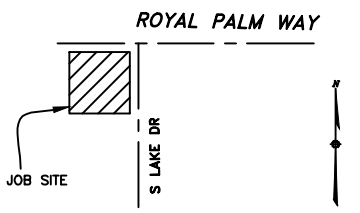

LOCATION SKETCH

N.T.S.

The location and existence of any facilities may not be relied upon by the supplier in responding to a bid or in complying with any contract. Supplier is responsible for evaluating site conditions both above and below ground including underground facility locations.




Ground Rod Information		
Location	Feet of Ground Rod Installed	Resistance (Ohms)

P.M. DISC. SW# 4160 GRID# 6-8222-4160-5-9	
COMPARTMENT 1	COMPARTMENT 2
SW.#40500 6-8222-4160-1-6 WEST TO SUBSTATION FDR 0134	SW.#40498 6-8222-4160-2-4 WEST TO VAULT A10EM174 SW# 13430
COMPARTMENT 4	COMPARTMENT 3
SW.#40499 6-8222-4160-4-1 EAST TO VAULT A10EV61 SW.#13404	A20799-1/A18350-6 B20800-1/B18351-4 C20801-1/C18352-4 FUSE 3# @ 150 "E" 6-8222-4160-3-2

FOR CONT. SEE
DWG# A10PP66

P.M. DISC. SW# 4159 GRID# 6-8222-4159-5-8	
COMPARTMENT 1	COMPARTMENT 2
SW.#40496 6-8222-4159-1-5 WEST TO VAULT A10EM174 SW# 13325 FDR 0133	SW.#40497 6-8222-4159-2-3 EAST TO VAULT A10EV61 SW# 13404
COMPARTMENT 4	COMPARTMENT 3
A(FUT) B(FUT) C(FUT) FUSE 3# @ 100 "E" 6-8222-4159-4-0	A20799-6 B20800-6 C20801-6 FUSE 3# @ 150 "E" 6-8222-4159-3-1

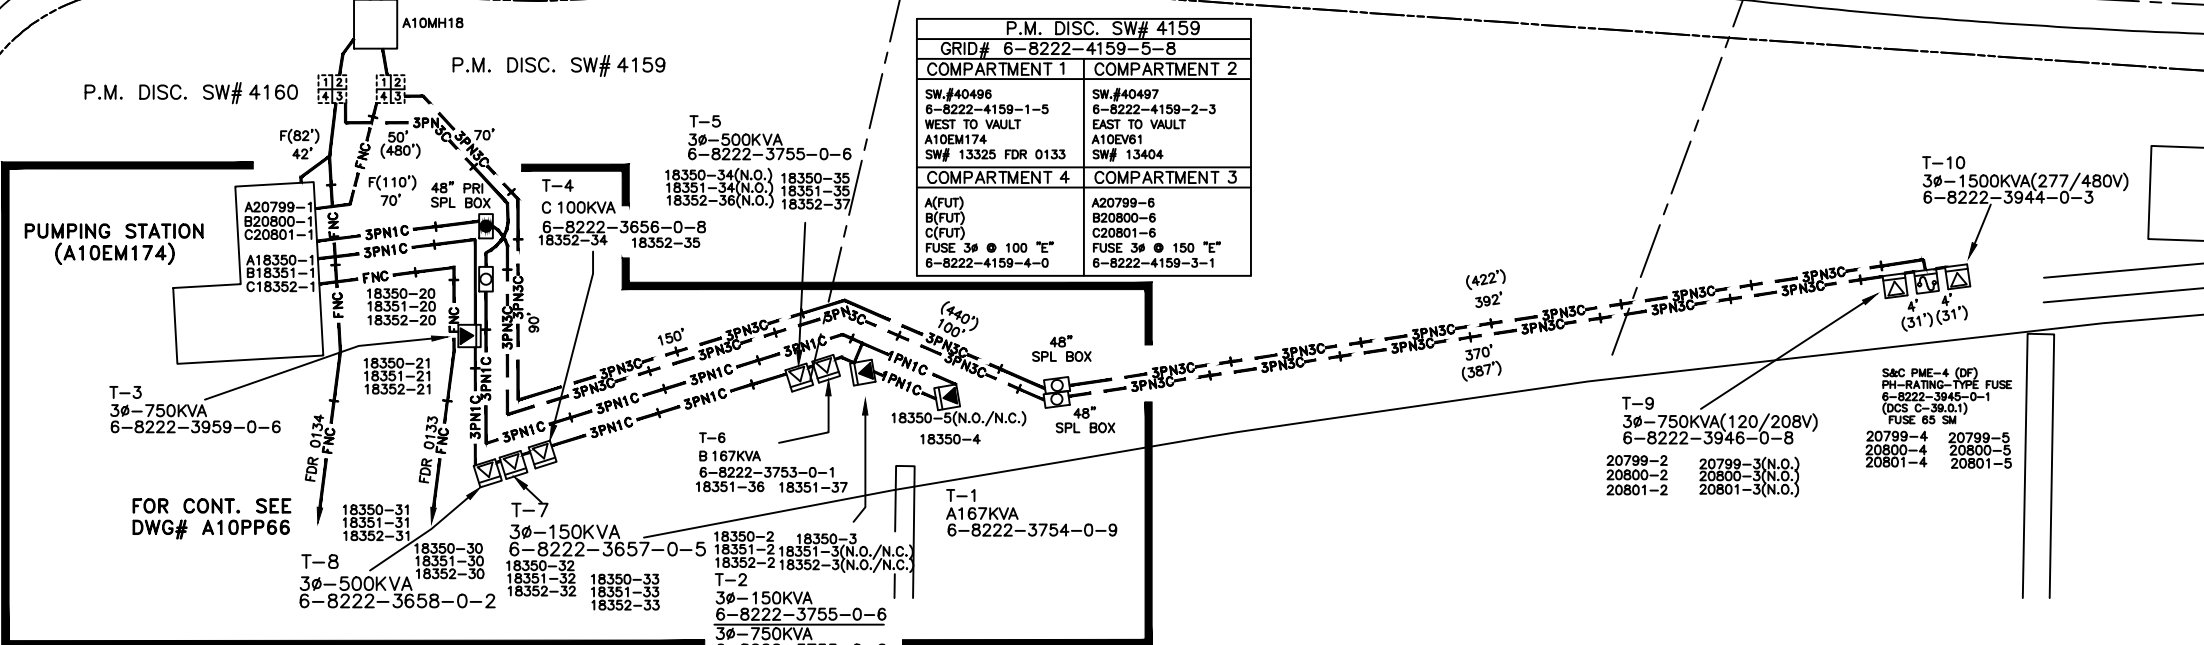

FOR CONT. SEE
DWG# A10PP66

THIS DRAWING SUPERSEDES
DWG A10BR184 8/26/19

REFERENCE DWG's

- A10CK447
- A10EM174
- A10PP66
- A10F95
- A10BR184